



PV Master APP



SEMS Portal APP



LinkedIn



Official Website



JIANGSU GOODWE POWER SUPPLY TECHNOLOGY CO.,LTD

No. 90 Zijin Rd., New District, Suzhou, 215011, China

www.goodwe.com

service@goodwe.com

SECU-A Series User Manual

Low Voltage Lithium Battery

Rev1.2
2021-03-02

Contents

1. Statement.....	01
2. Symbols Explanation.....	02
3. Product Overview.....	03
4. Cable Connection.....	03
4.1 Power Cable Connection.....	03
4.2 Communication Cable Connection.....	05
5. Battery Commissioning	06
5.1 Calibrating the DIP switch.....	06
5.2 Powering on the battery system.....	06
5.3 Setting the parameters of SECU-A5.4L On PV Master app.....	07
6. Error Code and Warning Code	07
7. Battery Parameters	09
8. Safety Instructions.....	10
9. Disclaimer.....	11

1. Statement

This document contains safety information and instructions on installing, connecting and commissioning. Please finish reading this document before taking any actions on the system.

This manual introduces the installation and commissioning of SECU-A5.4L battery. Please read through the manual and follow the instructions to use SECU-A5.4L battery.

This document is valid for the ***** from firmware version *****.

This document only contains brief information and may deviate from the real system.

Any Failure to follow this document instruction will make any manufacturer's warranty, guarantee or liability null and void unless you can prove that the damage was not due to non-compliance.

SECU-A5.4L battery is used with GoodWe ESA/ES/EM/SBP/BP series products. The battery is designed for indoor use. But in a ESA system, the battery is protected by the ESA enclosure, which could be used outdoors.

The system is not suitable for supplying life-sustaining medical devices. Please ensure that no personal injury would lead due to the power outage of the system.

Alterations to the GoodWe system, e.g., changes or modifications are not allowed unless the written permission of GoodWe is achieved.

The enclosed document is an integral part of this system. Keep the documentation in a convenient, dry place for future reference and observe all instructions contained therein.

The instructions in this document may only be performed by qualified persons who must have the following skills:

- Knowledge of how batteries work and are operated
- Knowledge of how an inverter works and is operated
- Knowledge of, and adherence to the locally applicable connection requirements, standards and directives* (*the local standard for Australia is AS/NZS 5139:2019)
- Knowledge of, and adherence to this document and the associated system documentation, including all safety instructions
- Training in dealing with the hazards associated with the installation and operation of electrical equipment and batteries
- Training in the installation and commissioning of electrical equipment

The battery must be stored, installed or operated under secured environment, including:

- Ambient temperature shall be -10°C~ 50°C
- Keep it away from corrosive liquids or environment
- Keep it dry, away from any inductive liquid
- No high flammable or explosive materials nearby

2 Symbols Explanation



Observe the documents
Observe all documents with the system.



Grounding conductor
This symbol indicates the position for connecting a grounding conductor.



WEEE designation
Do not dispose of the system together with household waste but in accordance with the disposal regulations for electronic waste applicable at the installation site.



CE mark
The system complies with the requirements of the applicable EU directives.



Please it straight up, without inclination or upside down.



Handle with care



Keep it dry



Keep the battery away from open flame or ignition sources.



Beware of electrical voltage.



Beware of a danger zone
This symbol indicates that the system must be additionally grounded if additional grounding or equipotential bonding is required at the installation site.



Keep the battery modules away from children.




Do not short circuit.



No more than five (5) identical packages being stacked on each other.

3 Product Overview

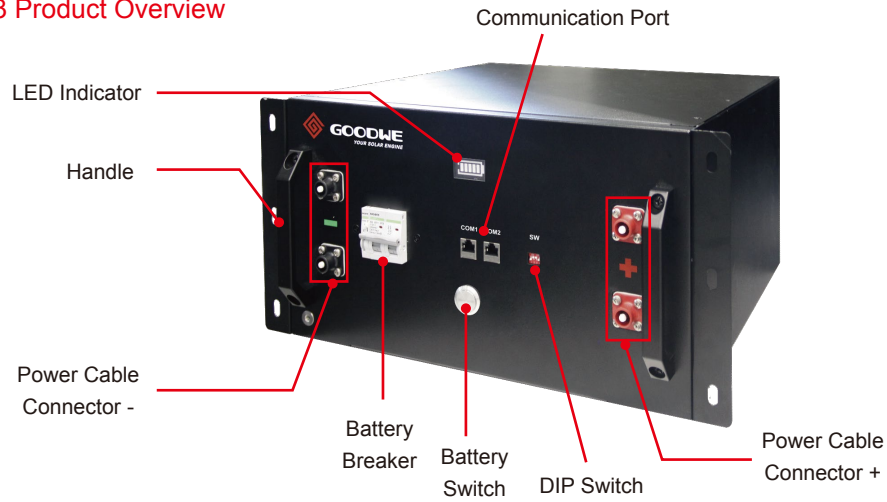

Note:

The two COM ports on battery are of the same function.
The two Power Cable Connector + or - on battery are of the same function.

4 Cable Connection


4.1 Power Cable Connection

Note:

- The battery is designed for GoodWe ESA, ES, EM, SBP, BP series energy storage system. Before installation, make sure battery is not damaged and battery breaker is switched OFF. And whole energy storage system is isolated from both AC and DC power.
- Before installation and cable connection, make sure battery is not damaged and battery breaker is switched OFF. And whole ESA cabinet is isolated from both AC and DC power.
- Battery packs shall be connected in parallel.
- Each SECU-A5.4L unit has two sets of Power Cable Connector - and +, which functions the same. Any of the two sets could be used for power connection.
- Please make sure the positive and negative pole on both battery and inverter side not reversed, otherwise the inverter or battery could be damaged.
- The unused battery connectors must be sealed with connector cover.
- When replacing or expanding the battery system, it is prohibited to connect the battery to the system, please contact the after-sales service for processing.
- Please refer to the inverter user manual for specific connectors on each inverter. We just take SBP and ESA series inverter as example to introduce the connection in this manual.


Power cable connection of SECU-A5.4L with ES, EM, SBP and BP inverters

When SECU-A5.4L is used with ES, EM, SBP and BP series inverters, the power cable needs to be prepared by the user, the recommended conductor cross-sectional area is 25mm².

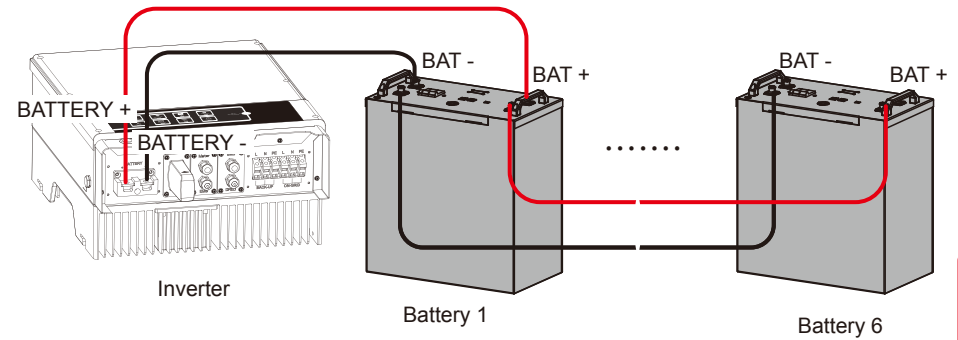

Power cable connection of single unit of SECU-A5.4L with ESA inverter

- Before installation and cable connection, make sure the whole ESA cabinet is isolated from both AC and DC power.
- The cables between the battery and the inverter are connected in the same way. Please refer to the "Cable connection of SECU-A5.4L with ES, EM, SBP and BP inverters".
- Open battery enclosure and install batteries and other component by sequence as below:

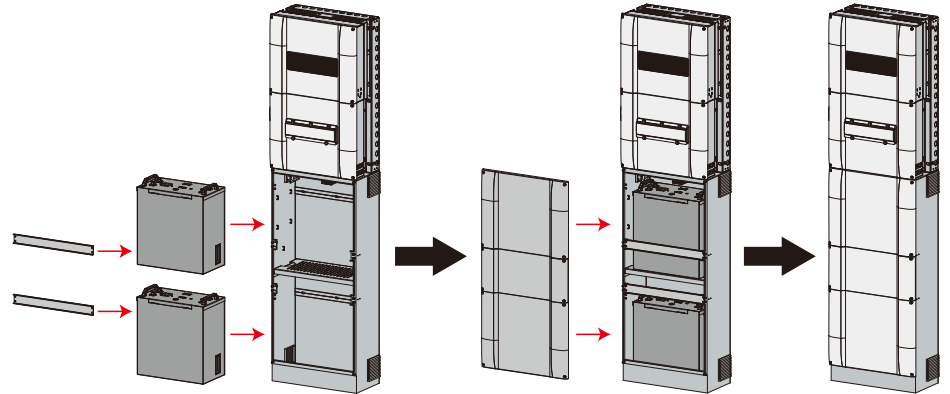



4.2 Communication Cable Connection

Communication cable connection of SECU-A5.4L with ES, EM, SBP and BP inverters

When SECU-A5.4L is used with ES, EM, SBP and BP series inverters, the network cable needs to be prepared by the user.


PIN	Colour	Function
1	Orange and White	N/A
2	Orange	N/A
3	Green and White	N/A
4	Blue	CAN_H
5	Blue and White	CAN_L
6	Green	N/A
7	Brown and White	N/A
8	Brown	N/A

RJ45 connector

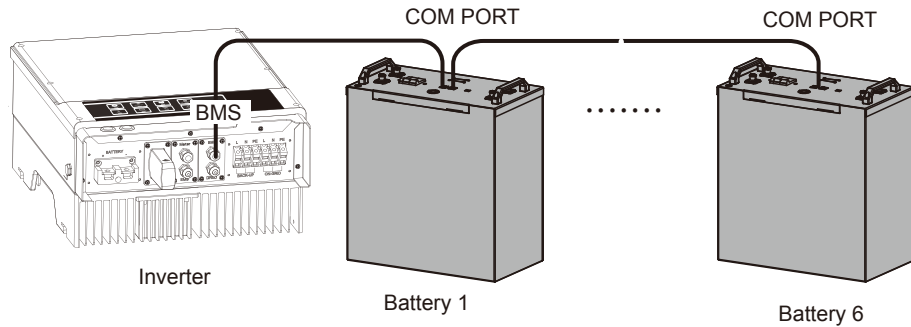

Communication cable connection of SECU-A5.4L with ESA inverter

In battery enclosure, battery cable and communication cable is preset inside. Connect directly these cables on battery to the right position:

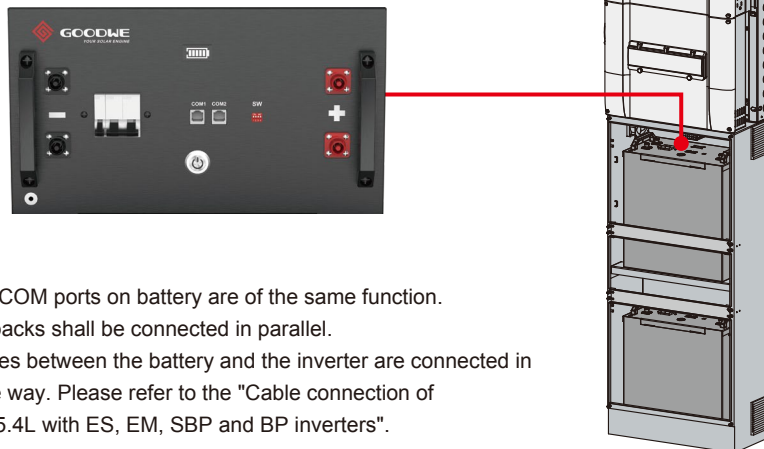

Note:

1. The two COM ports on battery are of the same function.
2. Battery packs shall be connected in parallel.
3. The cables between the battery and the inverter are connected in the same way. Please refer to the "Cable connection of SECU-A5.4L with ES, EM, SBP and BP inverters".


5. Battery Commissioning

5.1 Calibrating the DIP switch


- The DIP switches shall be configured differently between single piece battery and 2 battery paralleling system.
- We just take SBP series inverter system as an example, the calibration method of the DIP switch for ESA series inverter system is the same.

DIP	Function	Description
2	Terminal Resistance Switch	To recognize the last battery connected to inverter
3	GoodWe communication protocol Switch	To relize the communication between inverter and inverter unit part

Single Unit Of SECU-A5.4L System

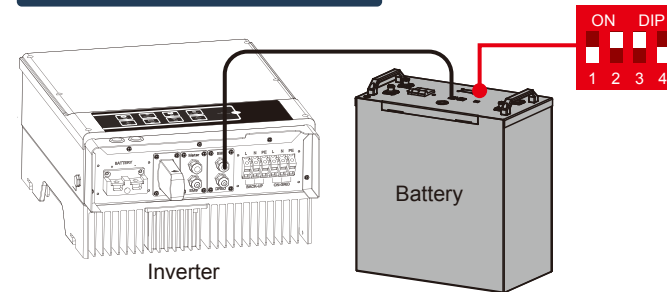

2~6 Units Of SECU-A5.4L System

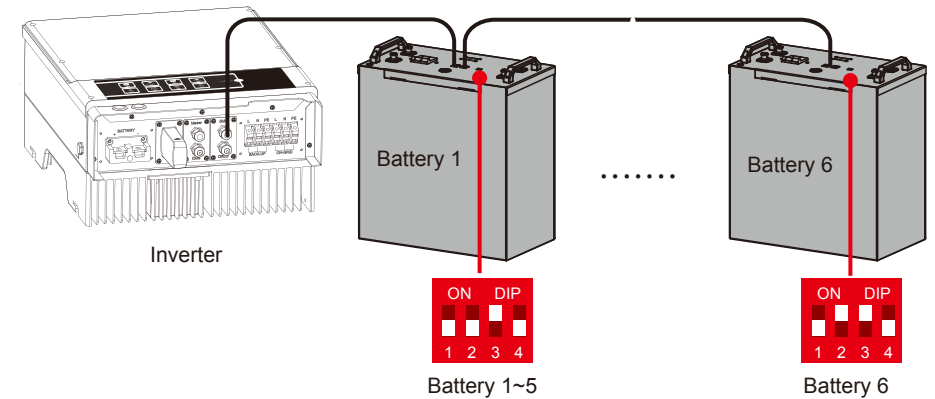


5.2 Powering on the battery system

1. Check all cables are connected correctly.
2. Turn on the battery break.
3. Turn on all battery switches within 30 seconds in the system. If it exceeds 30 seconds, there will be a error alarm.

Battery Switch

TURN ON	TURN OFF
Keep Pressing 2 seconds	Keep Pressing > 5 seconds

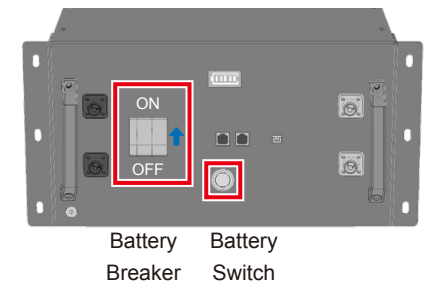


Note: Please follow the instruction to turn on/off battery in case of any damage on battery modules.


5.3 Setting the parameters of SECU-A5.4L On PV Master app

To make sure the battery communicates to inverter unit successfully, users have to use PV Master to choose the right battery option on PV Master:

APP Installation And Connection:

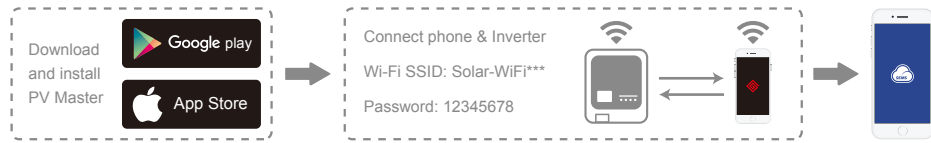

Select Battery on PV master



- SECU-A5.4L*1
- SECU-A5.4L*2
- SECU-A5.4L*3
- SECU-A5.4L*4
- SECU-A5.4L*5
- SECU-A5.4L*6


Select "SECU-A5.4L" on battery page in PV Master Application

Notes:

1. Select wrong battery will lead to BMS communication failure
2. Select wrong number of batteries the input and output current will be limited and the parameter indicated by the converter is inconsistent with the actual value of the battery.
3. For the complete commissioning of the whole ESA system, please go to ESA instruction.

5.4 Observing the indicator status.

LED Indication

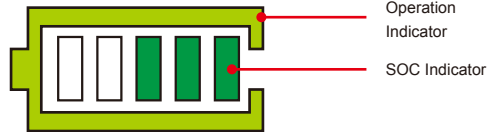

Operation Indicator	
Green, Blink 1s	Standby
Green, Blink 10s	Normal
Green, Blink 3s	Warning
Red, Blink 3s	Error

Operation Indicator	
	SOC < 5%
	5% ≤ SOC ≤ 25%
	25% ≤ SOC ≤ 50%
	50% ≤ SOC ≤ 75%
	75% ≤ SOC ≤ 95%
	95% ≤ SOC ≤ 100%

6. Error Code and Warning Code

Warning Status

Operation LED	SOC LED	Warning Description
Green Blink 3 seconds		Cell Temperature Difference
		Battery High Temperature
		Discharge Under Low Temperature
		Charge Overcurrent
		Discharge Overcurrent
		Battery Over Voltage
		Battery Under Voltage
		Charge Under Low Temperature

Note: If Battery Under Voltage happens during working status, by pressing battery switch for 5 times in 10 seconds, BMS will compulsively close MOS, so that inverter will detect battery open circuit voltage to charge battery.

Error Status

Operation LED	SOC LED	Error Description	Solution
Red Blink 3 seconds		Temperature Sensor Failure	Reboot battery or contact aftersales
		MOS Fault	
		Breaker Open	Turn Off battery and contact aftersales
		DIP Switch Status difference	Keep same of DIP switch status and reboot battery
		Slave Communication Loss	Reconnect communication cable
		NO SN	Contact aftersales
		Master Communication Loss	Reconnect communication cable
		Firmware Inconsistency	Contact aftersales
		Multi Master Unit	Turn off and reboot all batteries in 30s
		MOS Over temperature	Turn off battery for 2 hours

7. Battery Parameters

Physical Parameters	
Model	SECU-A5.4L
Battery Type	LiFePO ₄
System Weight	49kg
Dimensions(W x D x H)	400x226.2x484.2mm
Protection	IP20 (indoor)
Installed Capacity	5.4 kWh
Usable Energy	4.8 kWh
DOD	90%
Nominal Voltage	51.2 V
Operating Voltage Range	48 ~ 57.6 V
Internal Resistance	≤ 20 mΩ
Electrical Parameters	
Max. Charge current	50 A
Max. Discharge current	50 A
Operating Temperature Range	-10 °C ~ 50 °C [1]
Humidity	15% ~ 85%
System Configuration	
Module Connect	6 Parallels
Capacity Range	5.4/10.8/16.2/21.6/27/32.4 kWh
Usable Energy Range	4.8/9.6/14.4/19.2/24/28.8 kWh
Max. Charge Current	50A (1 Module) / 100A (2~6 Modules)
Max. Discharge Current	50A (1 Module) / 100A (2~6 Modules)
Monitoring Parameters	system voltage, current, cell voltage, cell temperature, PCBA temperature
Communication	CAN
Certification	CE, UN38.3

[1] When the temperature is below zero, the battery are not allowed to charge. When above 40 °C, the power output decreased.

8. Safety Instructions

The system has been designed and tested under international safety requirements. However, to prevent personal injury and property damage and ensure long-term operation of the system, do read this section carefully and observe all safety information at all times.

Battery Module Leakage

If the battery modules leak electrolyte, please avoid contact the leaking liquid or gas. If one is exposed to the leaked substance, do these actions:

Inhalation: Evacuate the contaminated area, and seek for medical help immediately.

Eye contact: Rinse your eyes with clean water for at least 15 minutes and seek for medical help immediately.

Skin contact: Wash the affected area thoroughly with soap and clean water, and seek for medical help immediately.

Ingestion: Induce vomiting, and seek for medical help immediately.

Firefighting Measures

- In case of a fire, please make sure that a carbon dioxide extinguisher or Novac1230 or FM-200 is nearby. Water cannot be used to extinguish the fire. (ABC is not effective for this battery firefighting)
- Full protective clothing and self-contained breathing apparatus are required for the firefighters to extinguish the fire.

Warning: Under >150°C environment, there is possibility that battery could explode

Handling and Storage Guide

- The battery modules and its components shall be protected from damage when it is in transporting and handling
- Please take the weight of the battery module system into account during transportation and battery module shall be lifted carefully
- Do not impact, pull, drag or step on the battery modules, either insert unrelated objects into any part of the battery modules
- The battery module shall be kept away from a fire, water, strong oxidizers or solvents
- The battery modules cannot be stored in high temperature (> 60°C) or stored directly under the sun, or in any high humidity environment.
- Do not use the battery modules if it is defective, or appears cracked, broken.
- Do not attempt to open, disassemble, repair, tamper with, or modify the battery modules without official permission from GoodWe.

Warning: battery module damage may lead to electrolyte explosive air leakage, please contact technical support immediately.

Warning of Electric Shock

It is danger to get electric shock when live components or DC cables are touched.

Disconnect the battery from voltage source before working on the device. Make sure of no any manual operation under load. And do not touch non-insulated parts or cables. And wear suitable protective equipment for all work on the system.

Warning: If battery is wetted, make sure it is not touched by hand, and contact technical support

Surge Protection

Over voltages can be further conducted into the building or other connected devices in the same network via network cables or other cables if there is no surge protection.

Ensure that the system is integrated into the existing surge protection.

9. Disclaimer

→ All the information in this document is the property of GoodWe No part of this document could be reproduced in any way for business use. Internal use is allowed.

→ GoodWe makes no representations or warranties express or implied, with respect to this document or any of the equipment and/or software it may describe, including (with no limitation) any implied warranties of utility, merchantability, or fitness for any particular purpose. All such representations or warranties are expressly disclaimed. Neither GoodWe nor its distributors or dealers shall be liable for any indirect, incidental, or consequential damages under any circumstances.

→ The exclusion of implied warranties may not apply in all cases under some statutes, and thus the above exclusion may not apply.

→ Specifications are subject to change without notice. Every effort has been made to make this document complete, accurate and up-to-date. However, GoodWe may need to make some improvements under certain circumstances without advance notice. GoodWe shall not be responsible for any loss caused by this document including, but not limited omissions errors, typographical errors, arithmetical errors or listing errors in this document.